



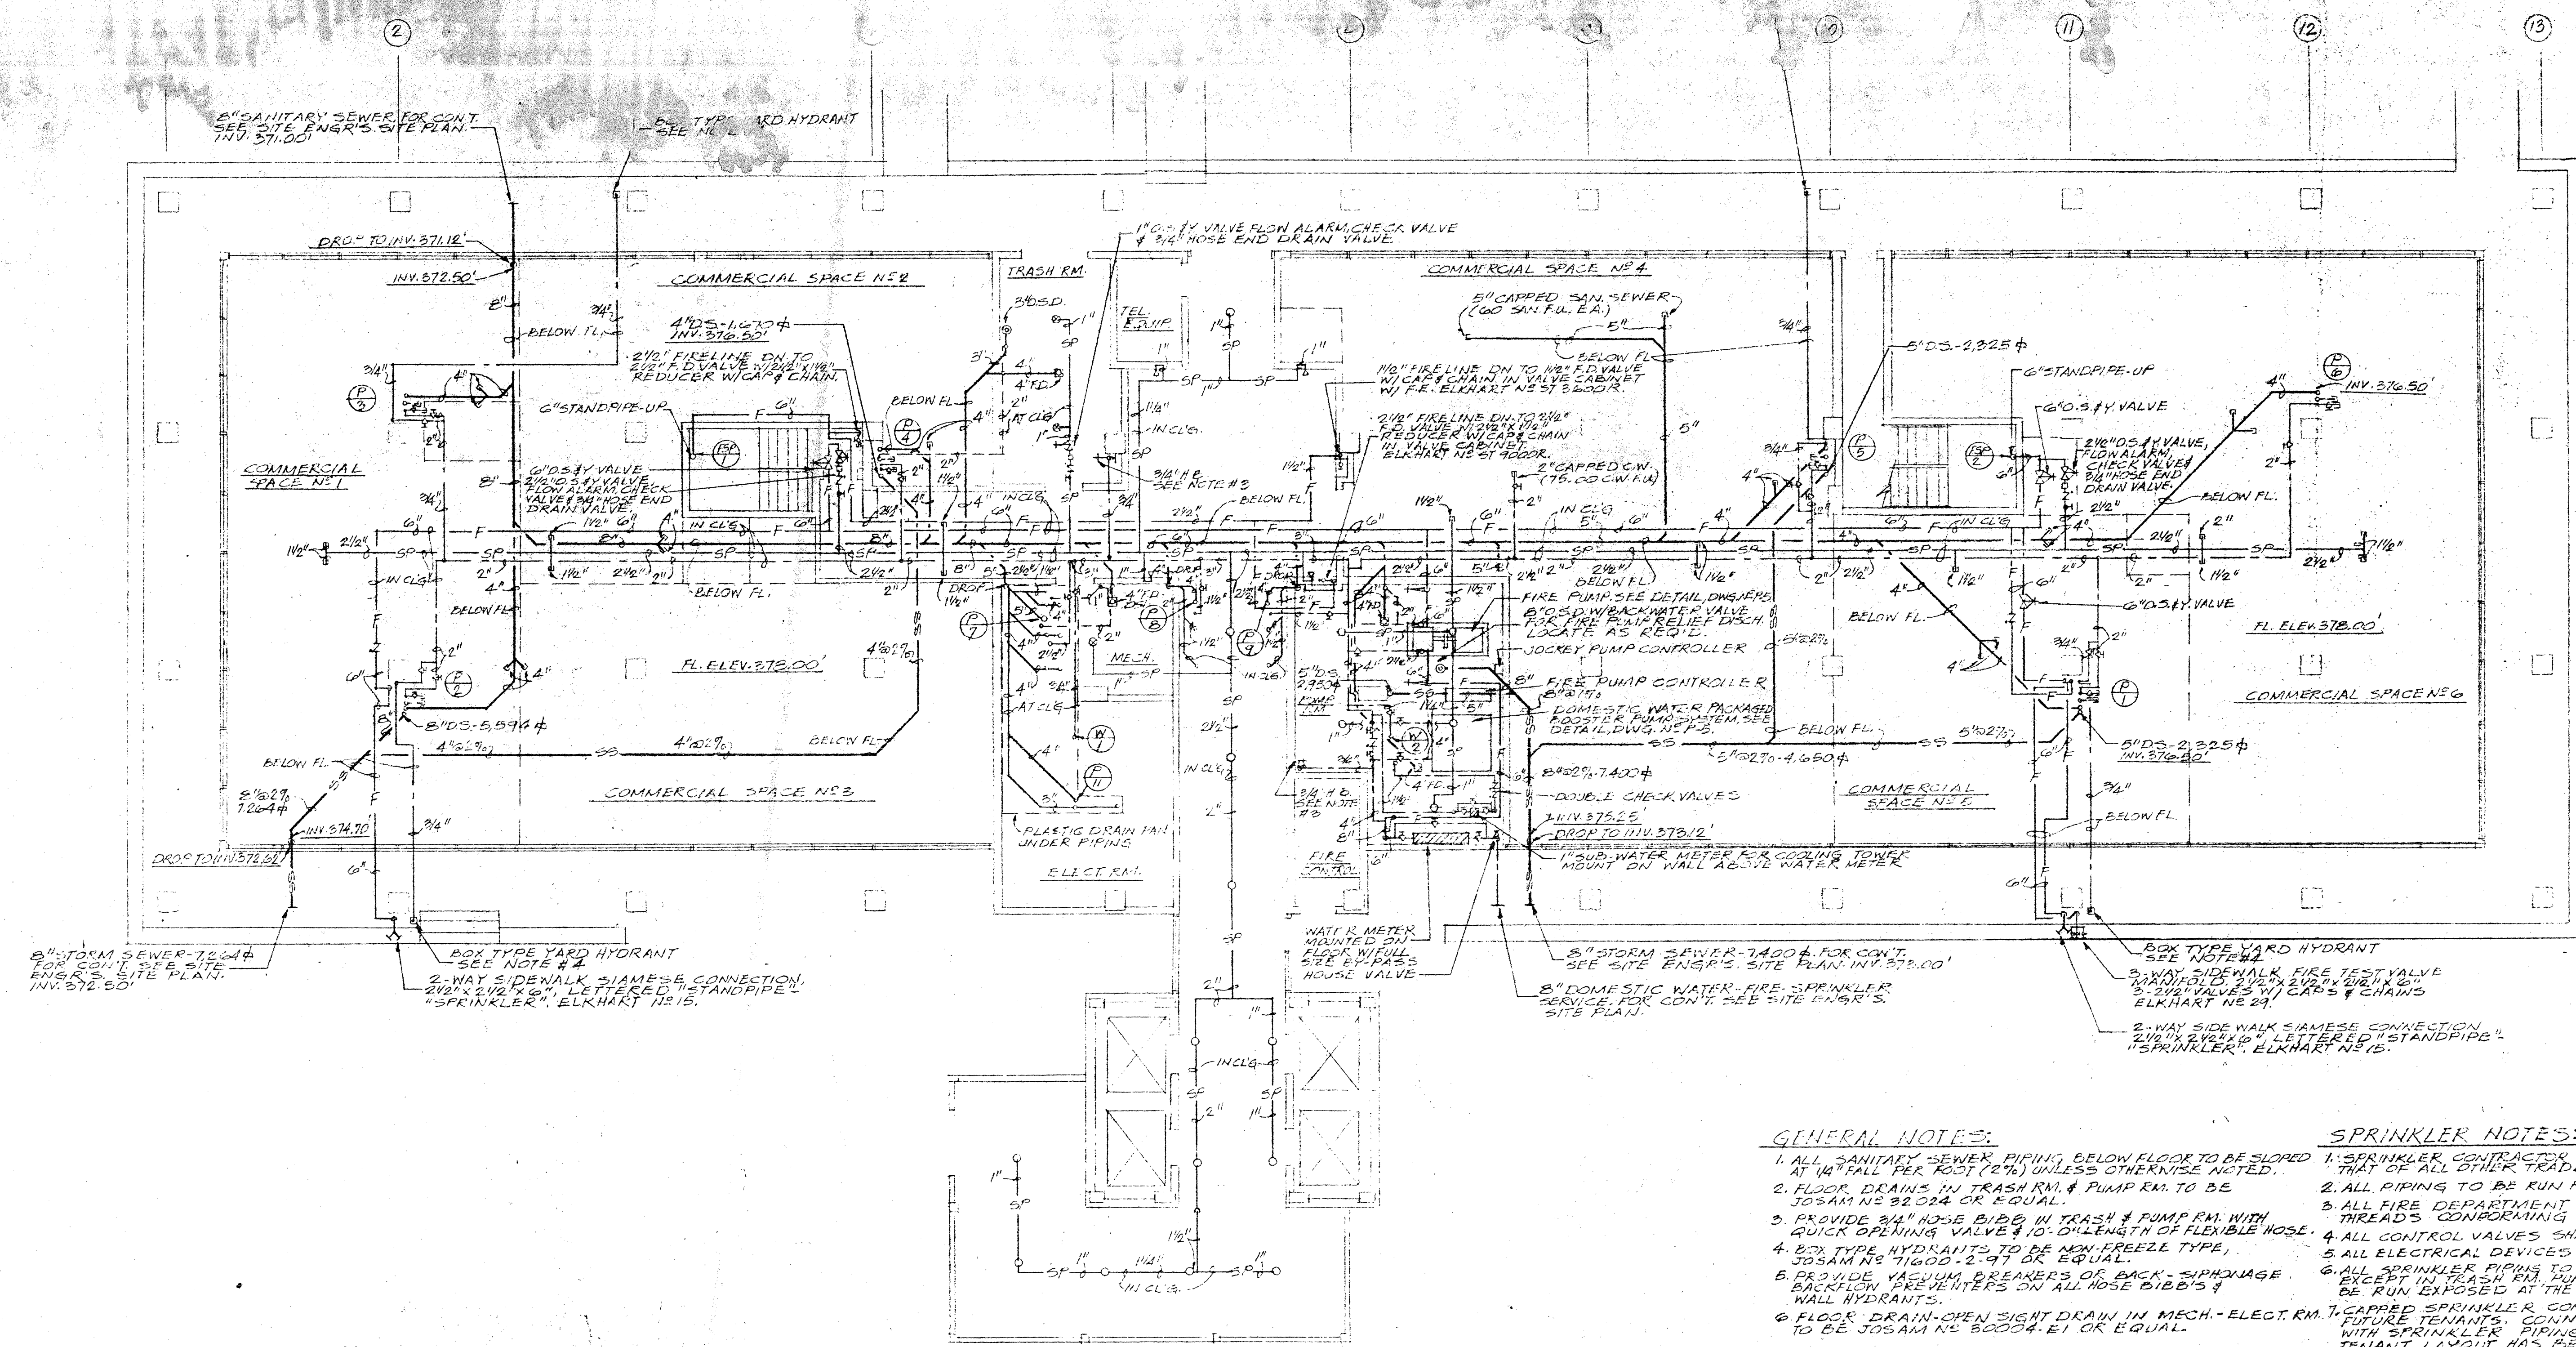

FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"

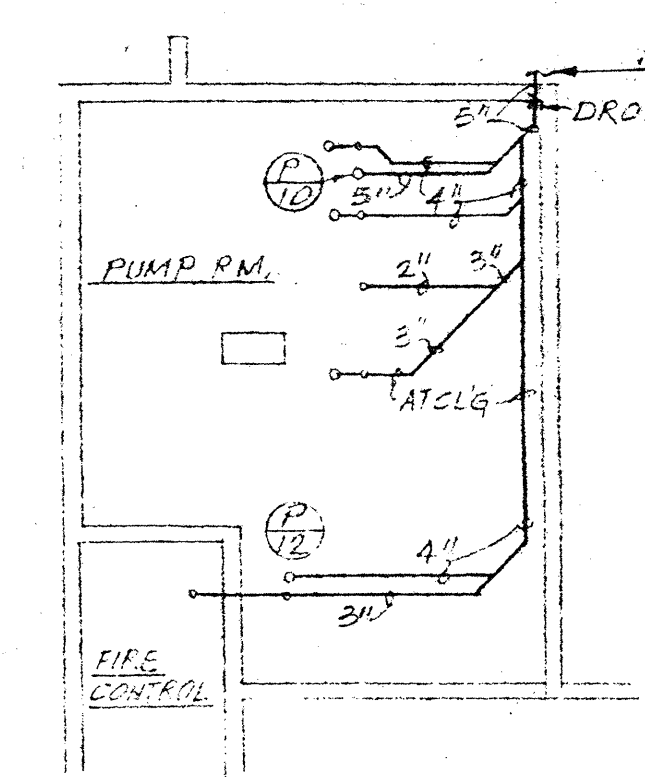

PART PLAN-PUMP ROOM
SHOWING SEWER PIPING AT CLG.
SCALE: 1/2" = 1'-0"

GENERAL NOTES:

- 1. ALL SANITARY SEWER PIPING BELOW FLOOR TO BE SLOPED AT 1/4" FALL PER FOOT (2%) UNLESS OTHERWISE NOTED.
- 2. FLOOR DRAINS IN TRASH RM. & PUMP RM. TO BE JOSAM NO. 32-224 OR EQUAL.
- 3. PROVIDE 3/4" HOSE BIBB IN TRASH & PUMP RM. WITH QUICK OPENING VALVE & 10'-0" LENGTH OF FLEXIBLE HOSE.
- 4. BOX TYPE HYDRANTS TO BE NON-FREEL TYPE, JOSAM NO. 71000-2-97 OR EQUAL.
- 5. PROVIDE VACUUM BREAKERS OR BACK-SIPHONAGE BACKFLOW PREVENTERS ON ALL HOSE BIBB'S & WALL HYDRANTS.
- 6. FLOOR DRAIN-OPEN SIGHT DRAIN IN MECH.-ELECT. RM. 1-CAPPED SPRINKLER CONNECTIONS HAVE BEEN PROVIDED FOR FUTURE TENANTS. CONNECT TO THESE CAPPED CONNECTIONS WITH SPRINKLER PIPING FOR TENANT AREA AFTER FINAL TENANT LAYOUT HAS BEEN DETERMINED. FINAL LAYOUT OF SPRINKLER TO BE CO-ORDINATED WITH LIGHTING LAYOUT & WITH THAT OF ALL OTHER TRADES.

SPRINKLER NOTES:

- 1. SPRINKLER CONTRACTOR SHALL CO-ORDINATE HIS WORK WITH THAT OF ALL OTHER TRADES.
- 2. ALL PIPING TO BE RUN PITCHED TO DRAIN.
- 3. ALL FIRE DEPARTMENT HOSE CONNECTIONS SHALL HAVE THREADS CONFORMING TO THOSE OF THE LOCAL FIRE DEPARTMENT.
- 4. ALL CONTROL VALVES SHALL BE INSTALLED WITH TAMPER SWITCHES.
- 5. ALL ELECTRICAL DEVICES SHALL BE COMPATIBLE WITH FIRE ALARM SYSTEM.
- 6. ALL SPRINKLER PIPING TO BE RUN CONCEALED ABOVE THE CEILING EXCEPT IN TRASH RM. & MECH. ROOM WHERE PIPING IS TO BE RUN EXPOSED AT THE CEILING.

5/12/79 FOR CONSTRUCTION